


BELL HOLES

ACCEPTABLE BEDDING

1/8 BEND CONNECTION TO TEE

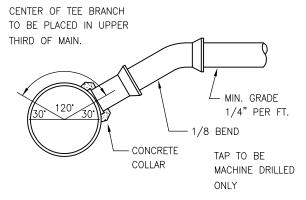


UNACCEPTABLE BEDDING

1/8 BEND & SADDLE CONNECTION

NOTES:

- 1. BELLS SHALL NOT TOUCH THE SIDES OR BOTTOM OF THE BELL HOLE.
- 2. THE BARREL SECTION SHALL BE SUPPORTED THROUGHOUT ITS LENGTH.
- SERVICE TAPS SHALL BE IN-LINE TEE OR MACHINE TAPPED. HAND TAPS SHALL NOT BE ALLOWED.
- 4. SERVICE LINES SHALL BE LOCATED 5'
 DOWNHILL FROM CENTERLINE OF THE LOT
 AND A MINIMUM OF 10' FROM THE WATER
 SERVICE LINE.
- 5. THE MIN. SERVICE LINE GRADE SHALL BE 1/4" PER FT.
- 6. JOINTS SHALL BE WATER TIGHT.
- 7. WHEN SERVICE STUB-INS ARE INSTALLED WITH THE SEWER MAIN, THEY SHALL BE EXTENDED AT LEAST TO PROPERTY LINE AND SHALL BE PLUGGED WITH A 2x4 MARKER FOR LOCATION OF END.

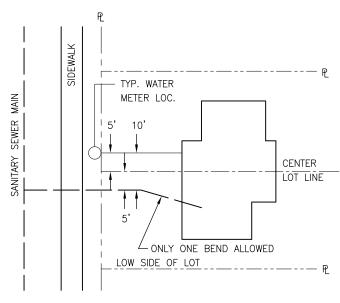

SEWER SERVICE



STANDARDS & SPECIFICATIONS

REVISED:

SANITARY SEWER SERVICE

DATE:

DRAWING NO. 300-13